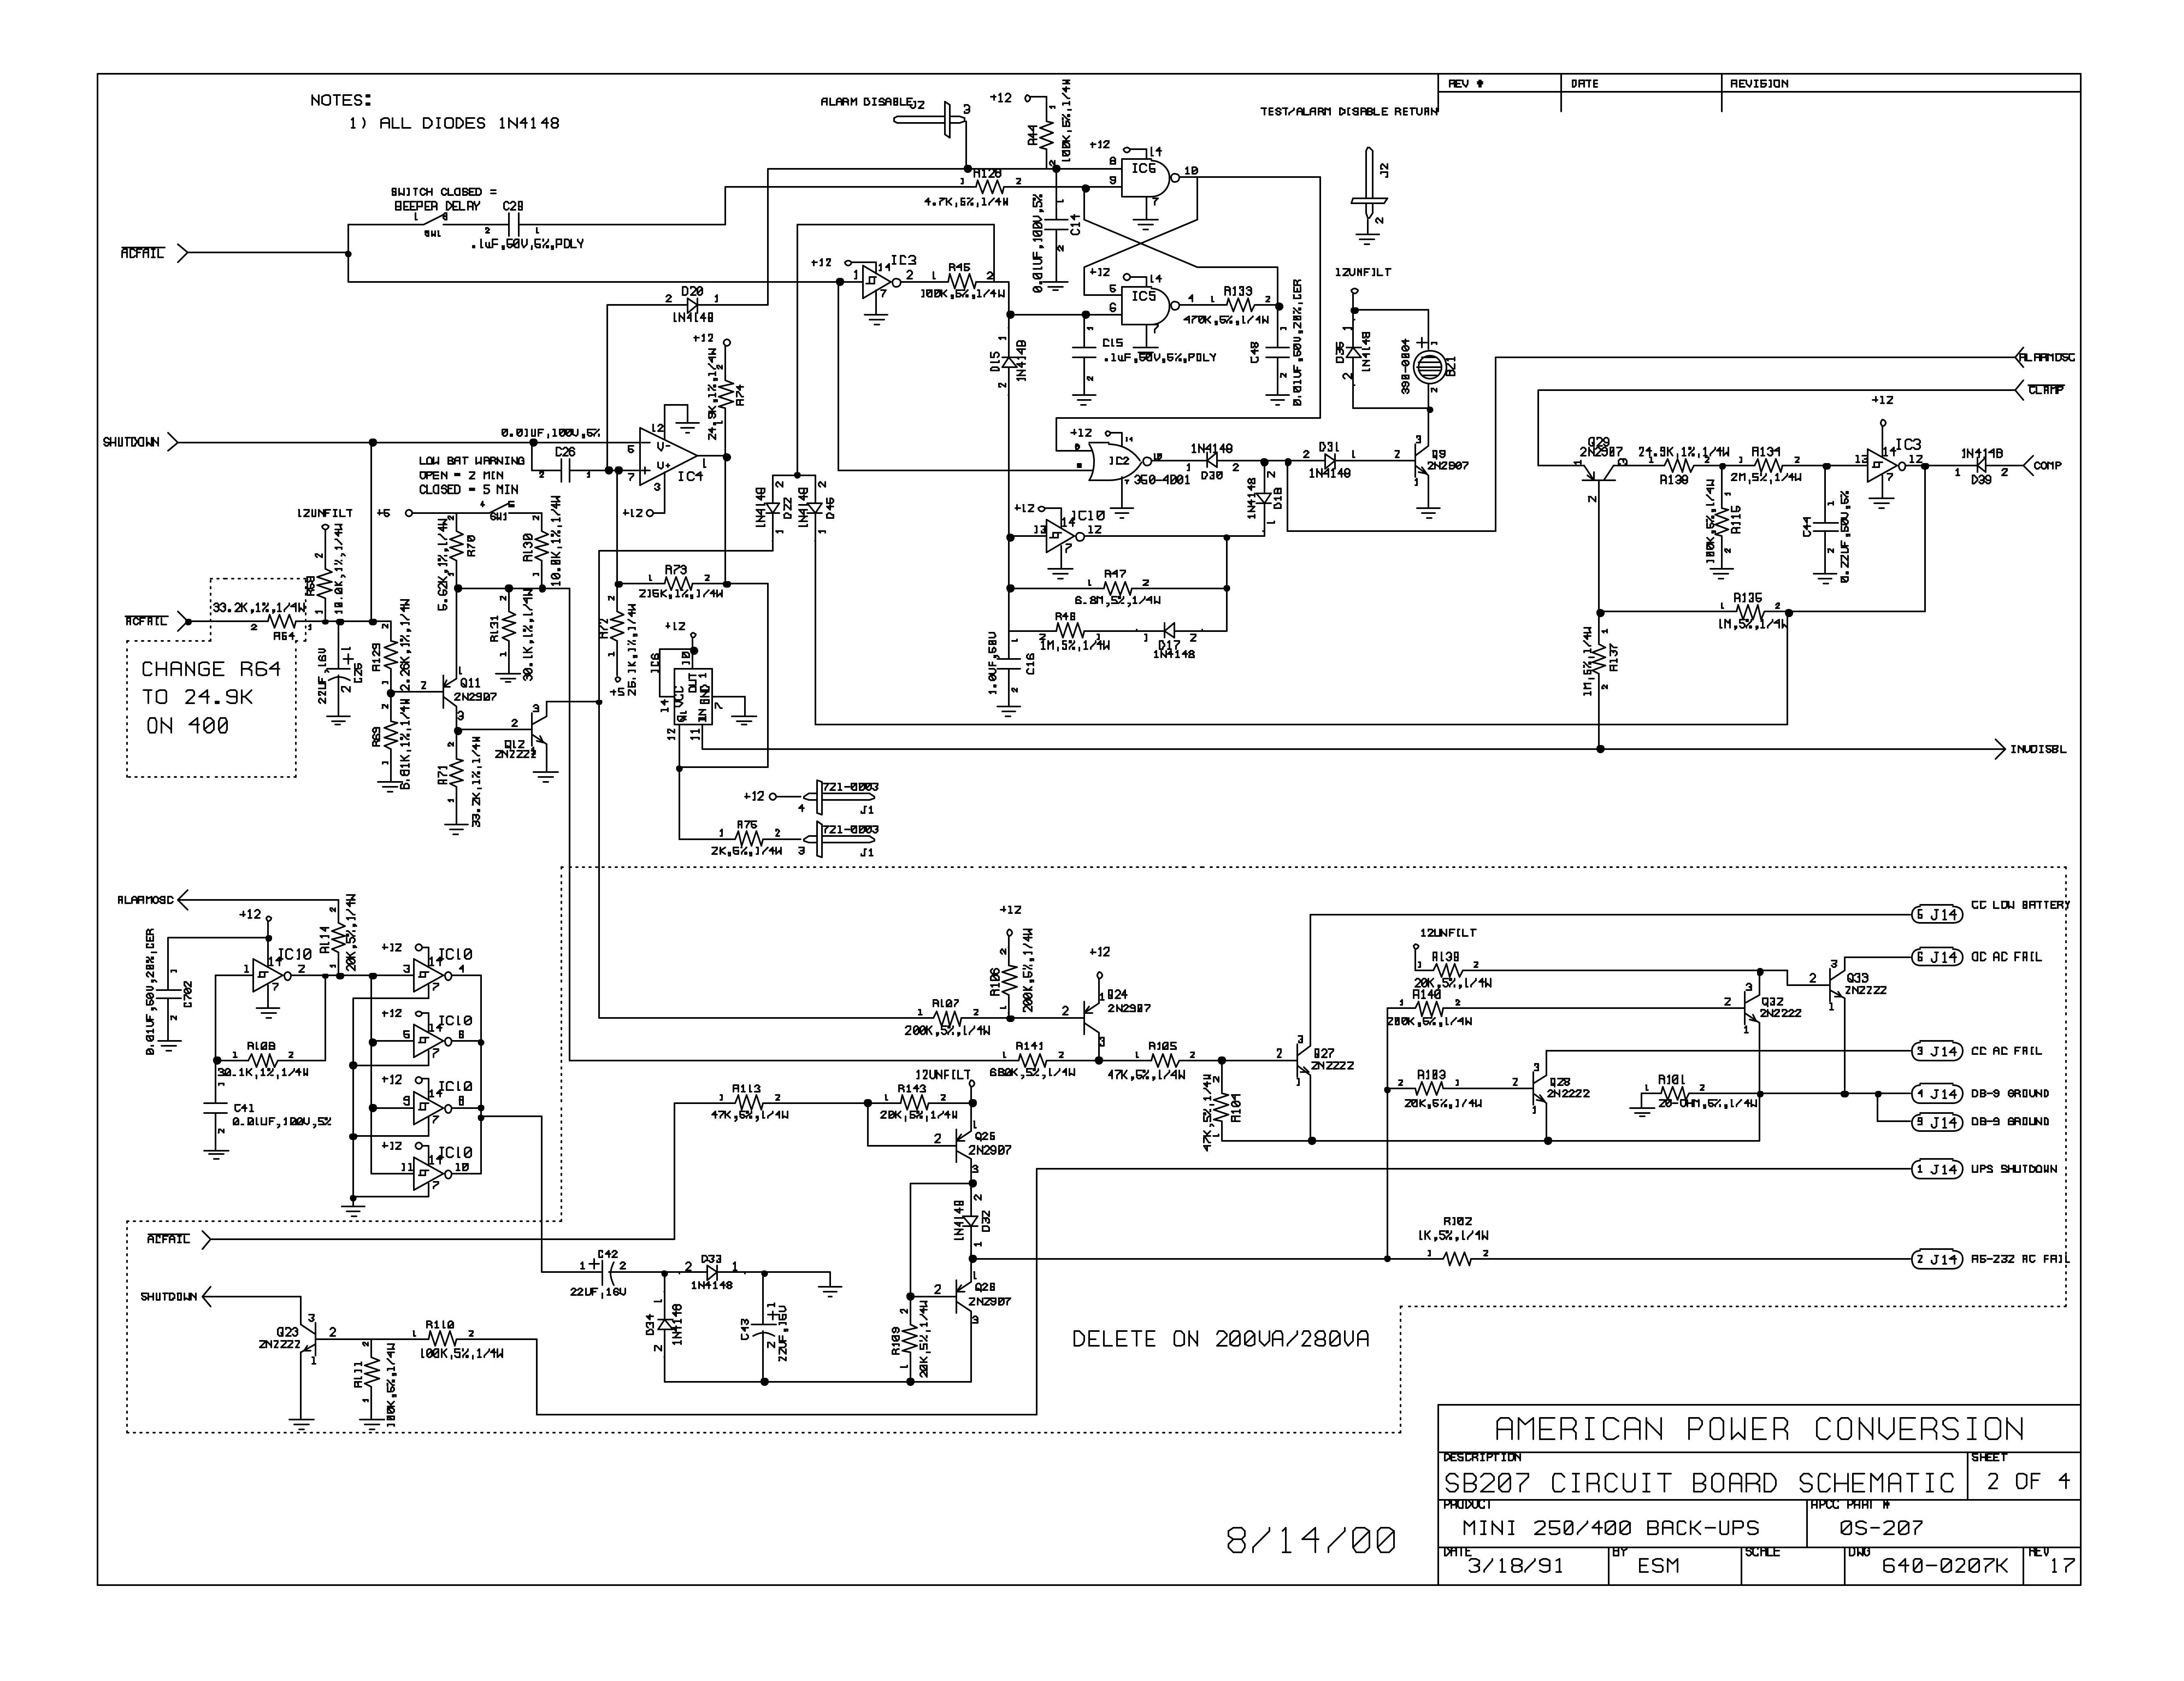

NOTES:
1) ALL DIODES 1N4148
ALARM DISABLE
TEST/ALARM DISABLE RETURN
REV #
DATE
REVISION
SWITCH CLOSED =
BEEPER DELAY
ACFAIL
SHUTDOWN
LOW BAT WARNING
OPEN = 2 MIN
CLOSED = 5 MIN
CHANGE R64
TO 24.9K
ON 400
ALARMOSC
CLAMP
COMP
INVDISBL
CC LOW BATTERY
OC AC FAIL
CC AC FAIL
DB-9 GROUND
UPS SHUTDOWN
RS-232 AC FAIL
DELETE ON 200VA/280VA
AMERICAN POWER CONVERSION
DESCRIPTION
SB207 CIRCUIT BOARD SCHEMATIC
SHEET
2 OF 4
PRODUCT
MINI 250/400 BACK-UPS
APCC PART #
0S-207
8/14/00
DATE
3/18/91
BY
ESM
SCALE
DWG
640-0207K
REV
17